## **AWTA PRODUCT TESTING**

Australian Wool Testing Authority Ltd - trading as AWTA Product Testing A.B.N 43 006 014 106

1st Floor, 191 Racecourse Road, Flemington, Victoria 3031 P.O Box 240, North Melbourne, Victoria 3051 Phone (03) 9371 2400

## TEST REPORT

Client: Signature Floorcoverings Pty Ltd

13 Wurundjeri Drive Epping VIC 3076 **Test Number** : 24-004342

Issue Date : 5/12/2024 Print Date : 5/12/2024


Order Number: 121511

Sample Description Clients Ref : Signature 4.5mm LVT"

Vinyl flooring End Use: Flooring

Nominal Composition: Vinyl

Nominal Mass per Unit Area/Density: 4.5mm

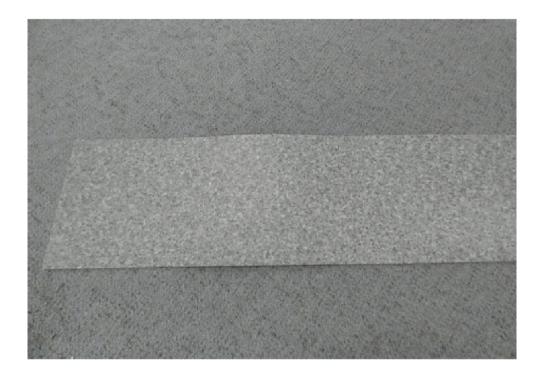

337701 73812 Page 1 of 2

 Australian Wool Testing Authority Ltd Copyright - All Rights Reserved



Accredited for compliance with ISO/IEC 17025 - Testing Accreditation Numbers: 983, 985, and 1356

Samples and their identifying descriptions have been provided by the client unless otherwise stated. AWTA Ltd makes nowarranty, implied or otherwise, as to the source of the tested samples. The above test results relate only to the sample or samples tested. This document shall not be reproduced except in full and shall be rendered void if amended or altered. This document, the names AWTA Product Testing and AWTA Ltd may be used in advertising providing the content and format of the advertisement have been approved by the Warragng Director of AWTA Ltd.





## **AWTA PRODUCT TESTING**

Australian Wool Testing Authority Ltd - trading as AWTA Product Testing A.B.N 43 006 014 106

1st Floor, 191 Racecourse Road, Flemington, Victoria 3031 P.O Box 240, North Melbourne, Victoria 3051 Phone (03) 9371 2400

## TEST REPORT

Client: Signature Floorcoverings Pty Ltd

13 Wurundjeri Drive Epping VIC 3076 Test Number : 24-004342 Issue Date : 5/12/2024

**Print Date** : 5/12/2024 **Order Number** : 121511

AS ISO 9239.1-2003

Reaction to Fire Tests for Floorings. Determination of the Burning Behaviour using a

**Radiant Heat Source** 

Date of Sample Arrival

31-10-2024

Date Tested

05-12-2024

CHF Value Non Directional 1 10.2

1

141

2 9.3

178

3 9.9 Mean 9.8 kW/m²

Smoke Value

2

3

137

Mean

152 %.min

Observations:

Non Directional

Melting Blistering Yes Yes

Each specimen was adhered to a substrate of 6mm thick fibre reinforced cement board using Roberts 656 adhesive and clamped prior to testing.

No directional properties, three specimens tested only.

HF30 not reported as flame out time occurred before 30 minutes.

The test results relate to the behaviour of the test specimens of a product under the particular conditions of the test, they are not intended to be sole criterion for assessing the potential fire hazard of the product in use.

Sample was conditioned in accordance with BSEN 13238:2010 at a temperature of 23±2°C and relative humidity of 50±5% for a minimum of 48 hours prior to testing.

Results in accordance with section 8.4 have not been included in the report. They are available upon request.

337701 73812

Copyright - All Rights Reserved

Page 2 of 2



Accredited for compliance with ISO/IEC 17025 - Testing Accreditation Numbers: 983, 985, and 1356

Samples and their identifying descriptions have been provided by the client unless otherwise stated. AWTA Ltd makes no warranty, implied or otherwise, as to the source of the tested samples. The above test results relate only to the sample or samples tested. This document shall not be reproduced except in full and shall be rendered void if amended or altered. This document, the names AWTA Product Testing and AWTA Ltd may be used in advertising providing the content and format of the advertisement have been approved by the Managino Director of AWTA Ltd.

Fiona McDonald

APPROVED SIGNATORY

MICHAEL A. JACKSON B.Sc.(Hons, MANAGING DIRECTOR

0204/11/06